



AT MAXIMUM BTU/HR INPUT,
MIN. GAS PRESSURE AT 14" W.C.
MAX. GAS PRESSURE = 2 PSI
(SEE NOTE 9)

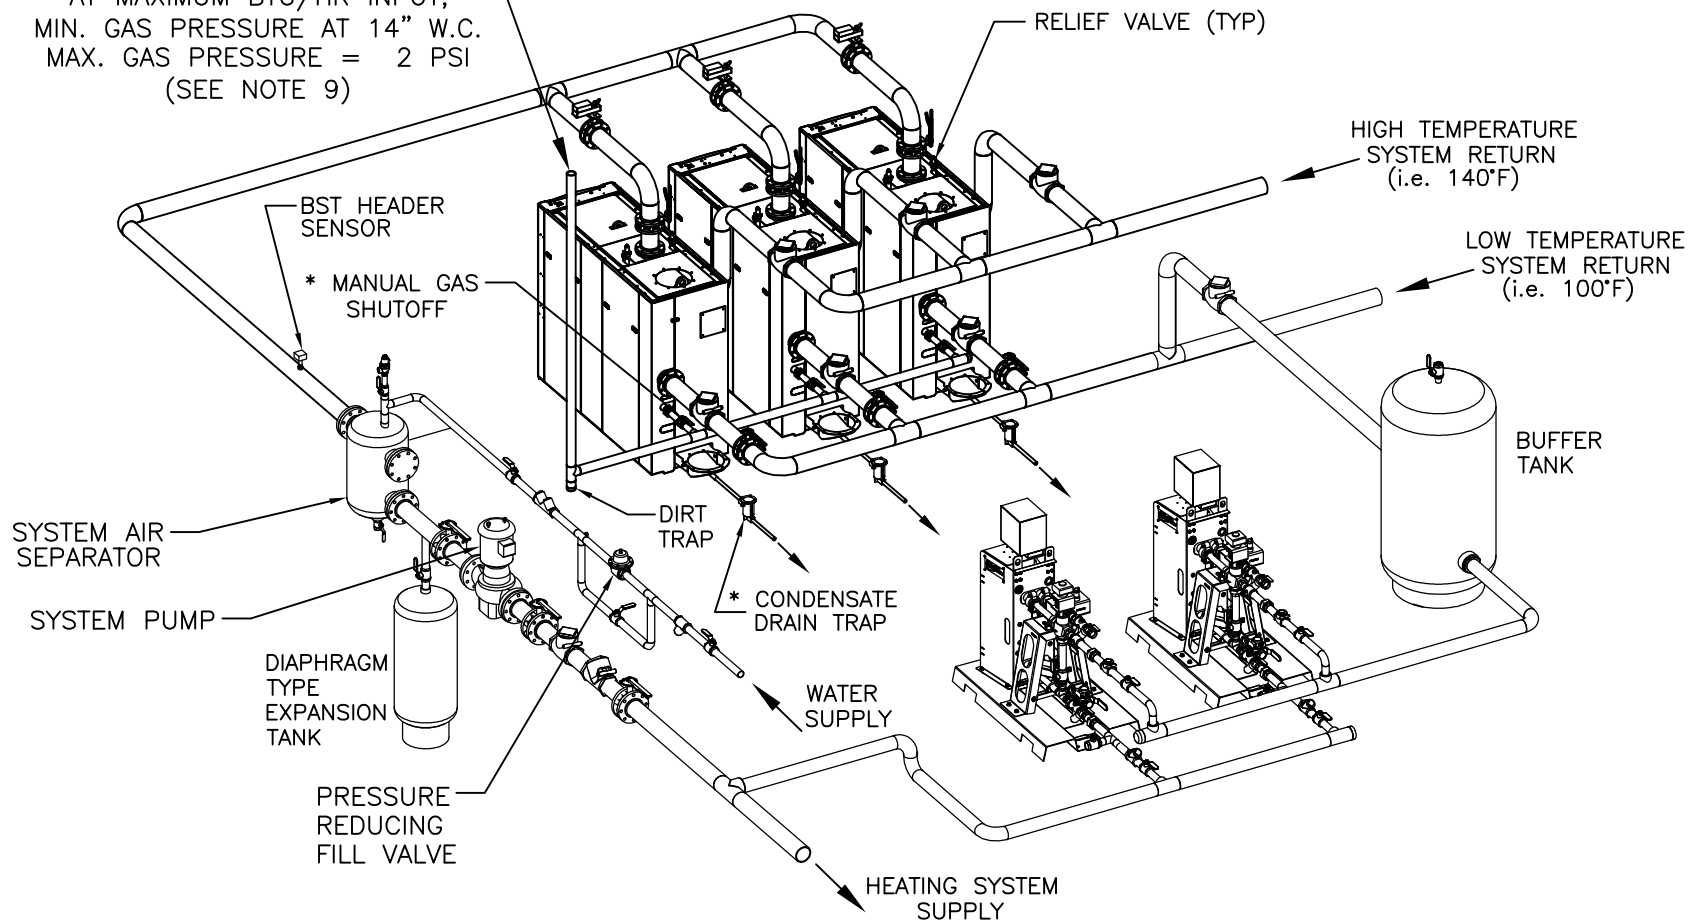

NOTES:

1. FOR ACTUAL SIZES AND LOCATIONS OF PIPING AND OTHER CONNECTIONS TO THE HEATER, SEE DIMENSIONAL DRAWING.
2. SHELL DRAIN VALVE AND CONDENSATE HOSE SHOULD BE ARRANGED TO PERMIT THE FLUIDS TO DRAIN FREELY, BY GRAVITY, TO A FLOOR DRAIN. RELIEF VALVE DISCHARGE SHOULD BE PIPED TO THE NEAREST FLOOR DRAIN. WHEN NO FLOOR DRAIN IS AVAILABLE, THE RELIEF VALVE DISCHARGE SHOULD BE PIPED VERTICALLY TO A HEIGHT 18" ABOVE THE FLOOR.
3. ALL (*) ITEMS ARE INCLUDED SEPARATELY IN SHIPMENT.
4. LOCATE WATER INLET AND OUTLET FITTINGS (i.e. UNIONS, ELBOWS, ETC.) A MINIMUM OF 6" FROM HEATER FITTINGS, TO PREVENT INTERFERENCE WITH REMOVAL OF BOILER PANELS AND COVERS. ALL PIPING AND ELECTRIC CONNECTIONS (SERVICE SWITCHES, CONDUIT BOXES) SHOULD LIKEWISE BE 6" AWAY FROM SIDE PANELS.
4. REFER TO SMARTPLATE APPLICATIONS GUIDE, SP-1010, FOR BUFFER TANK SIZING.
5. REFER TO SMARTPLATE INSTALLATION DRAWINGS FOR RECOMMENDED DOMESTIC PIPING INSTALLATION: SD-A-772, SD-A-773, SD-A-774, SD-A-775, SD-A-776, SD-A-777
6. SYSTEM PUMP OR SYSTEM DESIGN MUST MAINTAIN BENCHMARK 5000/6000 BOILER(S) REQUIRED MINIMUM FLOW OF 75 GPM.
7. THIS IS A TYPICAL INSTALLATION DRAWING. LOCAL CODES AND AUTHORITIES SHOULD BE CONSULTED.
8. WHEN USING THE AERCO CONDENSATE NEUTRALIZER TANK, FOR PROPER CONDENSATE DRAINAGE, THE NEUTRALIZER TANK MUST BE INSTALLED IN A PIT OR THE BOILER AND THE AERCO CONDENSATE TRAP MUST BE ELEVATED 4" OR HIGHER ABOVE THE FLOOR. SEE CONDENSATE TANK INSTRUCTIONS TID-0074 FOR DETAILS.
9. AT 2 PSI OR BELOW, A GAS REGULATOR IS OPTIONAL UNLESS REQUIRED BY LOCAL CODE.
10. ZERO-SIDE CLEARANCE NOT APPROVED FOR BENCHMARK® PLATINUM 5000/6000 MODELS.
11. USE OF BALANCING VALVES IS RECOMMENDED IF THE PIPING ARRANGEMENT IS NOT REVERSE RETURN.

 <small>A WATTS Brand</small>	100 ORITANI DRIVE BLAUVELT, NY 10913 aerco.com	
	BENCHMARK® PLATINUM 5000/6000 MBH LOW NO_x MULTIPLE UNIT INSTALLATION CCP WITH 2 PORT BUFFER TANK AND SMARTPLATE	
DWN. BY <u>K.S.</u> DATE <u>091216</u> SCALE <u>NTS</u> APPD. _____ DATE _____	SD-A-1122	REV. B