

COMMERCIAL LAUNDRY SIZING GUIDE

Natural Gas Modulating, Condensing Water Heater Models:

- INN600
- INN800
- INN1060
- INN1350

INNOVATION Series Gas-Fired Water Heaters



Revised : 05/02/2014

Technical Support:
(Mon–Fri, 8am-5pm EST)
1-800-526-0288

www.aerco.com

Disclaimer

The information contained in this manual is subject to change without notice from AERCO International, Inc. AERCO makes no warranty of any kind with respect to this material, including but not limited to implied warranties of merchantability and fitness for a particular application. AERCO International is not liable for errors appearing in this manual. Nor for incidental or consequential damages occurring in connection with the furnishing, performance, or use of this material.

THE AERCO INNOVATION COMMERCIAL LAUNDRY HOT WATER HEATER SYSTEM

The AERCO Innovation system recommended for commercial/industrial laundries (i.e. hospital or hotel laundries) is illustrated in Figure 1 (single unit) or Figure 2 (multiple units). Because laundries are subjected to periodic surge flows, supplementary storage is usually required to keep the maximum load on a gas-fired water heater within the heater's maximum capacity.

PRINCIPAL OF OPERATION

BTUs are stored in a stratified storage tank on a constant temperature-variable volume (of hot water) basis, i.e., the system depends on an absolute minimum of mixing of cold water and hot water in the tank. The discharge to the system is taken from the top of the tank and/or the heater. The supply of hot water in the upper portion of the tank is replenished at a constant rate by the heater operating at its maximum capacity. Tank storage must be large enough to accommodate the cumulative surge flows that occur in the maximum usage period.

Sizing and selection of the components is covered in the following explanation and example. System set up and adjustment consists simply of setting the system final outlet temperature and adjusting one balancing cock to set the circulating pump to operate at the correct point on its curve.

**DETERMINATION OF LAUNDRY HOT WATER REQUIREMENTS:
AVERAGE HOURLY HOT WATER RATE (AHHWR)**

Commercial laundry equipment generally uses two gallons or less of 180°F water per pound of cloths or linens washed. This figure is recommended by most machine manufacturers. Most "heavy" work requires a nominal one hour wash cycle, inclusive of loading and unloading the machine, and is based on a 50-60 second fill time. The use of the shorter 30 second fill time will shorten the total cycle only 3 to 4 minutes.

The shorter cycles more commonly used are not shorter because of shorter fill time, but, instead, are achieved by the elimination of a suds- or rinse-cycle or both. These are generally employed with synthetic fabrics which also use lower water temperatures. Thus, the figure of two gallons/pound of fabrics being washed can be considered to be two gallons/pound of machine capacity for determination of the AHHWR.

If a 30 second fill cycle is standard for the entire laundry operation, this figure might be increased 6 to 7% to 2.14 gallons/pound of machine capacity. However, the figures used are conservative enough to preclude this necessity.

$$\text{Average Hourly Hot Water Rate (AHHWR)} = (2) \cdot (\text{total machine capacity in pounds})$$

SIZING THE INNOVATION SERIES GAS-FIRED HEATER

$$\text{Heater Capacity (recovery rate) in GPM} = \frac{\text{AHHWR}}{60 \text{ mins.}} = \frac{2\text{GPH} \cdot \text{total machine capacity in pounds}}{60 \text{ minutes}}$$

(See Chart A for heater selection)

SIZING THE STRATIFIED STORAGE TANK

Approximately $\frac{2}{3}$ of the water usage in the normal laundry machine occurs in a 20 minute time period ($\frac{1}{3}$) hour. During this period, the heater can make only half of this required amount or $\frac{1}{3}$ of the hourly requirement.

The stratified storage tank must provide the other half or $\frac{1}{3}$ of a full hour requirement. Stratification within the tank precludes 100% usability. Standard practice has shown that the tank is able to deliver between 60% and 80% of its total capacity without excessive temperature degradation. AERCO recommends using 70% of the total capacity of an un-baffled vertical tank piped as shown in Figure 1.

$$\text{Storage Tank size in gallons} = \frac{2\text{GPH} \cdot \text{machine capacity in pounds}}{3 \cdot 0.7}$$

SIZING THE CIRCULATOR

Select the required pump flow rate from Chart B below, based on desired system set point and number of Innovation units selected. Head loss depends on loop piping.

Chart A - Heater Selection (GPM)

	(1) 600	(1) 800	(1) 1060	(1) 1350	(2) 800	(2) 1060	(2) 1350	(3) 1060	(3) 1350
40 - 140	11	15	20	26	30	40	52	60	78
40 - 160	10	13	17	21	26	34	42	51	63
40 - 180	8	11	14	18	22	28	36	42	54

Chart B - Circulator Selection (GPM)

	(1) 600	(1) 800	(1) 1060	(1) 1350	(2) 800	(2) 1060	(2) 1350	(3) 1060	(3) 1350
40 - 140	11	15	20	26	30	40	52	60	78
40 - 160	10	13	17	21	26	34	42	51	63
40 - 180	8	11	14	18	22	28	36	42	54

If recovery rate is less than or equal to capacities shown above, select that number of Innovation water heaters.

EXAMPLE: Given washer capacities of:

With a required temperature rise of 40°F – 160°F

1 400#
 1 200#
 1 100#
 1 75#
 Total= 775#

$$\text{AHHWR} = 2 \cdot 775\# = 1550$$

$$\text{Heater Capacity} = \frac{2 \cdot 775\#}{60} = 26 \text{ GPM; from Chart A: 2 INN800's}$$

$$\text{Tank Capacity} = \frac{2 \cdot 775\#}{3 \cdot 0.7} = 738 \text{ gallons}$$

$$\text{Circulator Capacity} = 26 \text{ GPM, from Chart B}$$

DETERMINATION OF MAXIMUM INSTANTANEOUS DEMAND (MID)

The nominal machine cycle of 45 to 50 minutes, exclusive of loading and unloading, is generally based on a 50 to 60 second time to fill to high fill level. Many machine manufacturers are currently recommending a 30 second fill time to fill to high level. While fill time has *no impact* on tank and circulator sizes, and none on heater capacity, it does impact *line sizes* and dictates the *maximum surge flow through the nozzles* which must be accommodated. Therefore, it is essential to be able to determine this flow for various “fill” times.

The factors used in the following examples are machine manufacturer’s recommended factors to account for diversity resulting from a varying number of machines and variations in machine sizes.

2-minute fill time

1 or 2 machines:

$$\text{MID} = 0.15\text{GPM} \bullet \text{capacity of largest machine in pounds}$$

3 or more machines:

$$\text{MID} = 0.15\text{GPM} \bullet \text{capacity of largest machines in pounds PLUS} \\ 0.10\text{GPM} \bullet \text{total capacity of all other machines in pounds}$$

1-minute fill time

1 or 2 machines:

$$\text{MID} = 0.30\text{GPM} \bullet \text{capacity of largest machine in pounds}$$

3 or more machines:

$$\text{MID} = 0.30\text{GPM} \bullet \text{capacity of largest machines in pounds PLUS} \\ 0.15\text{GPM} \bullet \text{total capacity of all other machines in pounds}$$

30-second fill time

1 or 2 machines:

$$\text{MID} = 0.60\text{GPM} \bullet \text{capacity of largest machine in pounds}$$

3 or more machines:

$$\text{MID} = 0.60\text{GPM} \bullet \text{capacity of largest machines in pounds PLUS} \\ 0.25\text{GPM} \bullet \text{total capacity of all other machines in pounds}$$

SELECTING TANK NOZZLES AND PIPE SIZES

Using the calculated MID, select a tank nozzle and pipe sizes from Chart C. Choose tank water inlet and outlet connections to keep velocities below 2 fps (feet per second). Choose sizes to velocities below 7 fps. Note on Figure 1 and Figure 2, that the piping between the tank and heater(s) does not see the MID, only the pumped flow rate. Therefore, this piping only needs to be selected for the pumped flow rate.

ALTERNATE SIZING: DESIGNING FOR NO SUPPLEMENTAL STORAGE

In a small laundry (up to 200 pound total machine capacity, and where fill times of 1 minute or longer are acceptable), it is practical to consider the use of the AERCO Innovation heater without any supplemental storage.

Heater capacity is selected equal to the maximum instantaneous demands (MID) as calculated for the standard system above.

EXAMPLE (Alternate Sizing): A small laundry with incoming water 40°F in winter and water to machines 160°F has the following laundry machines:

1-minute fill time

- 1 with 75 pound capacity
- 2 with 50 pound capacity each
- 175 pounds = Total Capacity


Heater Capacity:

MID for largest machine	=	75 pounds • 0.30GPM	=	22.5 GPM
MID for all other machines	=	2 • 50 pounds • 0.15GPM	=	15.0 GPM
		Total MID	=	37.5 GPM

From Chart A, heater selection is: two INN1350 heater units


Chart C – Velocity of water in fps (feet per second) in schedule 40 pipe for water at 60°F

GPM	2"	2 ½"	3"	3 ½"	4"	5"	6"	8"
6	0.574							
8	0.765							
10	0.956	0.670						
15	1.43	1.01						
20	1.91	1.34	0.868					
25	2.39	1.68	1.09	0.812				
30	2.87	2.01	1.30	0.974				
35	3.35	2.35	1.52	1.14	0.882			
40	3.83	2.68	1.74	1.30	1.01			
45	4.30	3.02	1.95	1.46	1.13			
50	4.78	3.35	2.17	4.62	1.36			
60	5.74	4.02	2.60	1.95	1.51			
70	6.70	4.69	3.04	2.27	1.76	1.12		
80	7.65	5.36	3.47	2.60	2.02	1.28		
90	8.60	6.03	3.91	2.92	2.27	1.44		
100	9.56	6.70	4.34	3.25	2.52	1.60	1.11	
125	11.97	8.38	5.43	4.06	3.15	2.01	1.39	
150	14.36	10.05	6.51	4.87	3.78	2.41	1.67	
175	16.75	11.73	7.60	5.68	4.41	2.81	1.94	
200	19.14	13.42	8.68	6.49	5.04	3.21	2.22	
225		15.09	9.77	7.30	5.67	3.61	2.50	1.44
250			10.85	8.13	6.30	4.01	2.78	1.60
275			11.94	8.93	6.93	4.41	3.05	1.76
300			13.00	9.74	7.56	4.81	3.33	1.92
325			14.12	10.53	8.19	5.21	3.61	2.08
350				11.36	8.82	5.62	3.89	2.34
375				12.17	9.45	6.02	4.16	2.40
400				12.98	10.08	6.42	4.44	2.56
425				13.80	10.71	6.82	4.72	2.73
450				14.61	11.34	7.22	5.00	2.89
475					11.97	7.62	5.27	3.04
500					12.60	8.02	5.55	3.21
550					13.85	8.82	6.11	3.53
600					15.12	9.63	6.66	3.85
650						10.43	7.22	4.17
700						11.23	7.78	4.49
750						12.03	8.33	4.81
800						12.83	8.88	5.13
850						13.64	9.44	5.45
900						14.44	9.99	5.77

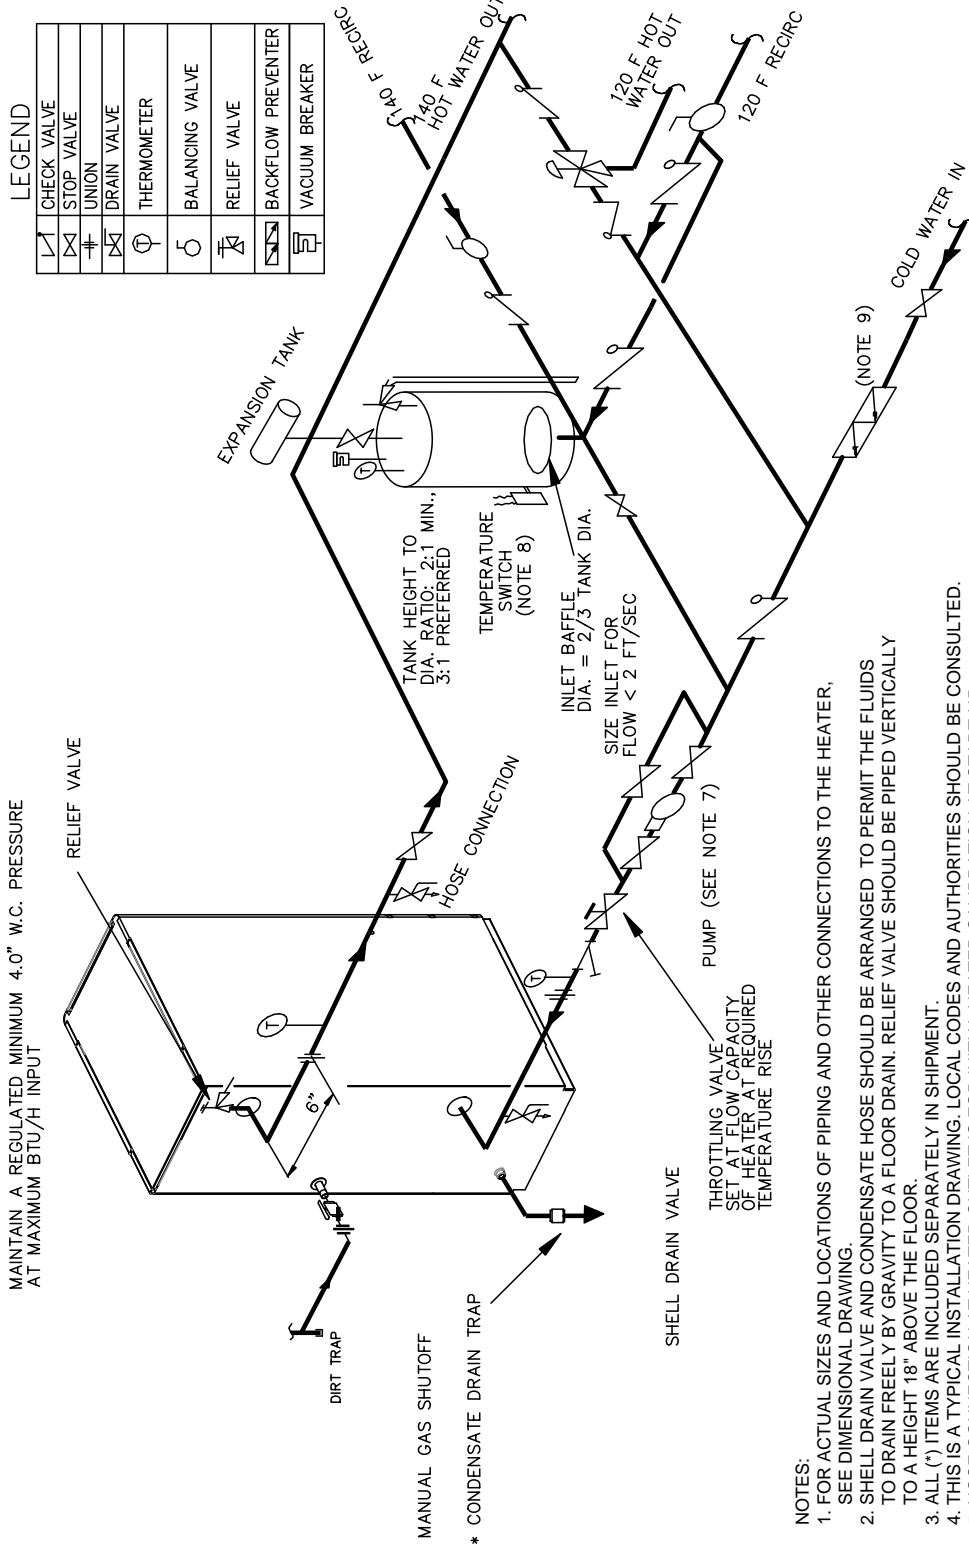

(Ref. SD-A-831A)

FIGURE 1

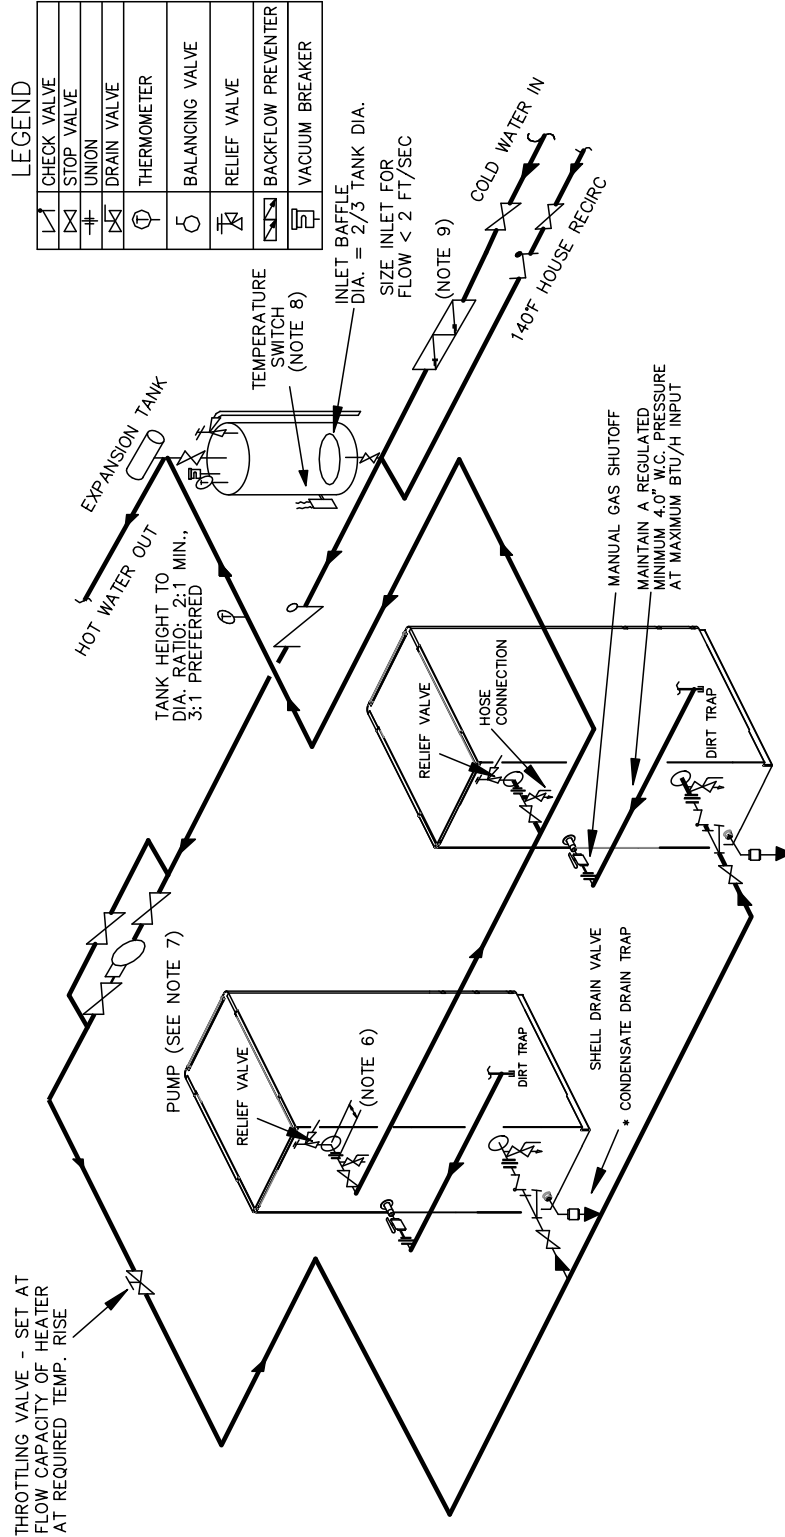

(Ref. SD-A-833A)

- NOTES:
1. FOR ACTUAL SIZES AND LOCATIONS OF PIPING AND OTHER CONNECTIONS TO THE HEATER, SEE DIMENSIONAL DRAWING.
 2. SHELL DRAIN VALVE AND CONDENSATE HOSE SHOULD BE ARRANGED TO PERMIT THE FLUIDS TO DRAIN FREELY BY GRAVITY TO A FLOOR DRAIN. RELIEF VALVE SHOULD BE PIPED VERTICALLY TO A HEIGHT 18" ABOVE THE FLOOR.
 3. ALL (*) ITEMS ARE INCLUDED SEPARATELY IN SHIPMENT.
 4. THIS IS A TYPICAL INSTALLATION DRAWING. LOCAL CODES AND AUTHORITIES SHOULD BE CONSULTED.
 5. HOSE CONNECTION AT HEATER OUTLET IS FOR INITIAL HEATER CALIBRATION AT START-UP.
 6. LOCATE WATER INLET AND OUTLET FITTINGS (i.e. UNIONS, ELBOWS, ETC.) A MINIMUM OF 6" FROM WATER HEATER FITTINGS TO PREVENT INTERFERENCE WITH REMOVAL OF HEATER PANELS.
 7. PUMP SHOULD BE CAPABLE OF HEATER'S RATED FLOW AT DESIGN TEMPERATURE RISE.
 8. MOUNT TEMPERATURE SWITCH 1/3 UP FROM THE BOTTOM OF THE TANK. SWITCH WILL TURN PUMP ON AND OFF.
 9. IF PERMITTED BY LOCAL CODES, A CHECK VALVE MAY BE USED IN PLACE OF A BACKFLOW PREVENTER.
 10. CONSULT LOCAL CODES FOR PROPER TYPE OF CONNECTIONS TO STORAGE TANK.
 11. WHEN REQUIRED BY LOCAL CODES, A VACUUM BREAKER MUST BE INSTALLED WITH THE STORAGE TANK.

FIGURE 2

Change Log

Date	Description	Changed By
05/02/2014	Rev C: PIR 934-66: Corrected example calculation, page 5	Chris Blair